


No XREFs  
i: \\Key\_Std\SAS\Details\dwg\Sasd-PUB-20s.dwg

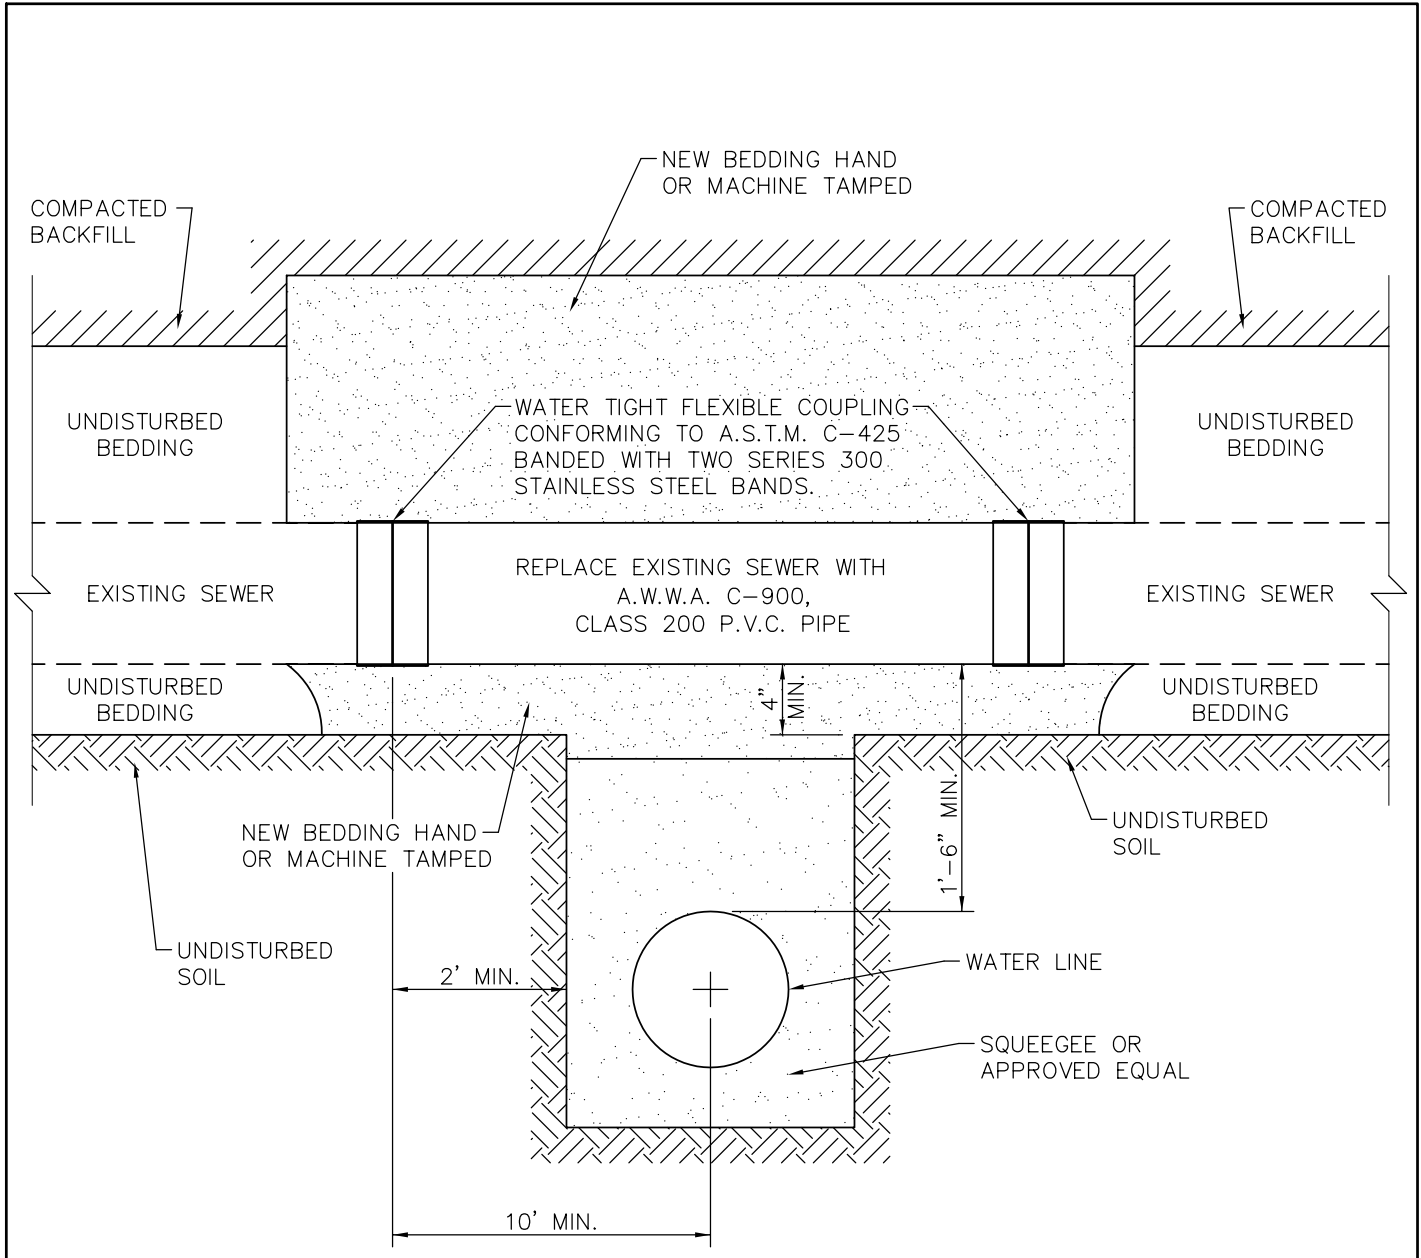

**NOTES:**

1. THIS STANDARD APPLIES ONLY FOR NON-PRESSURIZED SANITARY SERVICE TAPS AND SANITARY SEWERS EIGHT (8) INCH AND SMALLER. SANITARY SEWERS MAY NOT BE CUT WITHOUT THE EXPRESSED CONSENT OF THE DISTRICT. A DISTRICT REPRESENTATIVE WILL BE ON SITE DURING CONSTRUCTION.
2. DUCTILE IRON PIPE USED TO REPLACE SECTION OF SANITARY SEWER SHALL BE PLACED IN A TRENCH, BEDDED, BACKFILLED AND COMPACTED IN ACCORDANCE WITH THE DISTRICT SPECIFICATIONS.

**Kennedy/Jenks Consultants**  
**Engineers & Scientists**  
 143 Union Boulevard  
 Suite 600  
 Lakewood, CO 80228  
 303 985 3636 TEL.  
 303 985 3800 FAX



**SOUTH ARAPAHOE**  
**SANITATION DISTRICT**  
 www.southarapahoe.org

**SEWER CROSSING  
 DETAIL**

DRAWING NO.: SASD-PUB-20S DATE: 5/08